



COSMOLAB LABORATORIES, INC.

"Caring for the Environment through Quality Testing"



MICROBIOLOGICAL TEST RESULTS for DRINKING WATER DOH Water Laboratory Accreditation No. 04A-0006-2022-LW-2

NAME OF CLIENT: CARMONA WATER DISTRICT

RLA No.: ML 003195

Date: February 5, 2020

SAMPLE DESCRIPTION: Raw Water (Nimfa Capanayan)
Submitted By: Carmona Water District
Date Received: January 30, 2020
Date of Sampling: January 30, 2020
Time of Sampling: 8:41 AM
Place of Sampling: CWD D-Line San Pablo St., Silangan, Cabilang Baybay, Carmona, Cavite
Source of Sampling: Water District
CWD01G

Test Requested	Methodology	No. of Positive Tubes (out of five tubes)	Results	Standards
Total Coliform	Multiple Tube Fermentation	0	less than 1.1	less than 1.1
Thermotolerant Coliform (E. Coli)	Multiple Tube Fermentation	0	less than 1.1	less than 1.1

Test Requested	Description	Methodology	Results	Standards
Heterotrophic Plate Count	Total Microbial Load	Pour Plate Method	141	less than 500

Note: The methodology used for coliform detection is the Multiple Tube Fermentation Technique as required by the Department of Health. The Heterotrophic Plate Count or the Total Microbial Load is being determined using the Pour Plate Method. The HPC is required in determining water potability (PNSDW 2017)

REMARKS:

*The results showed that the water sample submitted **PASSED** the DOH standard for drinking water.*

Results are those obtained at time of examination and relate only to the sample/s tested.

REFERENCES:

Philippine National Standards for Drinking Water, 2017, Department of Health
Standard Methods for the Examination of Drinking Water and Wastewater
20th Edition, APHA, Washington, DC, 2005

Certified by:


Maricel S. Palogan, RMT
Laboratory Microbiologist
PRC Reg. No. 39410
WMLA-19-1008

Approved by:

Engr. Carlos B. Castromayor
Laboratory Manager
PRC Reg. No. 18428

Noted by:

Engr. An M. Vilamor
General Manager
PRC Reg. No. 53000



COSMOLAB LABORATORIES, INC.

"Caring for the Environment through Quality Testing"



MICROBIOLOGICAL TEST RESULTS for DRINKING WATER

DOH Water Laboratory Accreditation No. 04A-0006-2022-LW-2

NAME OF CLIENT: CARMONA WATER DISTRICT

RLA No.: ML 003195

Date : February 5, 2020

SAMPLE DESCRIPTION: Raw Water (Armando Cadiente)
Submitted By: Carmona Water District
Date Received: January 30, 2020
Date of Sampling: January 30, 2020
Time of Sampling: 9:15 AM
Place of Sampling: CWD D-Line Bulongan St., Brgy., Maduya, Carmona, Cavite
Source of Sampling: Water District
CCWD01G

Test Requested	Methodology	No. of Positive Tubes (out of five tubes)	Results MPN/100 ml	Standards MPN/100 ml
Total Coliform	Multiple Tube Fermentation	0	less than 1.1	less than 1.1
Thermotolerant Coliform (E. Coli)	Multiple Tube Fermentation	0	less than 1.1	less than 1.1

Test Requested	Description	Methodology	Results CFU/ml	Standards CFU/ ml
Heterotrophic Plate Count	Total Microbial Load	Pour Plate Method	33	less than 500

Note: The methodology used for coliform detection is the Multiple Tube Fermentation Technique as required by the Department of Health. The Heterotrophic Plate Count or the Total Microbial Load is being determined using the Pour Plate Method. The HPC is required in determining water potability (PNSDW 2017)

REMARKS:

The results showed that the water sample submitted PASSED the DOH standard for drinking water. Results are those obtained at time of examination and relate only to the sample/s tested.

REFERENCES:

Philippine National Standards for Drinking Water, 2017, Department of Health
Standard Methods for the Examination of Drinking Water and Wastewater
20th Edition, APHA, Washington, DC, 2005

Certified by :


Maricel S. Palogan, RMT
Laboratory Microbiologist
PRC Reg. No. 39410
WMLA-19-1008

Approved by:

Engr. Carlos B. Castromayor
Laboratory Manager
PRC Reg. No 18428

Noted by:

Engr. Ali M. Villamor
General Manager
PRC Reg. No. 53000



COSMOLAB LABORATORIES, INC.

"Caring for the Environment through Quality Testing"



MICROBIOLOGICAL TEST RESULTS for DRINKING WATER

DOH Water Laboratory Accreditation No. 04A-0006-2022-LW-2

NAME OF CLIENT: CARMONA WATER DISTRICT

RLA No.: ML 003195

Date : February 5, 2020

SAMPLE DESCRIPTION: Raw Water (Martillano Bagsic)
Submitted By: Carmona Water District
Date Received: January 30, 2020
Date of Sampling: January 30, 2020.
Time of Sampling: 1:27 PM
Place of Sampling: CWD D-Line Apartment Mapalad St., Mabuhay, Carmona, Cavite
Source of Sampling: Water District

Test Requested	Methodology	No. of Positive Tubes (out of five tubes)	Results	Standards
Total Coliform	Multiple Tube Fermentation	0	less than 1.1	less than 1.1
Thermotolerant Coliform (E. Coli)	Multiple Tube Fermentation	0	less than 1.1	less than 1.1

Test Requested	Description	Methodology	Results	Standards
Heterotrophic Plate Count	Total Microbial Load	Pour Plate Method	95	less than 500

Note: The methodology used for coliform detection is the Multiple Tube Fermentation Technique as required by the Department of Health. The Heterotrophic Plate Count or the Total Microbial Load is being determined using the Pour Plate Method. The HPC is required in determining water potability (PNSDW 2017)

REMARKS:

The results showed that the water sample submitted PASSED the DOH standard for drinking water. Results are those obtained at time of examination and relate only to the sample/s tested.

REFERENCES:

Philippine National Standards for Drinking Water, 2017, Department of Health
Standard Methods for the Examination of Drinking Water and Wastewater
20th Edition, APHA, Washington, DC, 2005

Certified by :


Maricela S. Palogan, RMT
Laboratory Microbiologist
PRC Reg. No. 39410
WMLA-19-1008

Approved by:

Engr. Carlos B. Castromayor
Laboratory Manager
PRC Reg. No 18428

Noted by:

Engr. Ali M. Villamor
General Manager
PRC Reg. No. 53000



COSMOLAB LABORATORIES, INC.

"Caring for the Environment through Quality Testing"



MICROBIOLOGICAL TEST RESULTS for DRINKING WATER DOH Water Laboratory Accreditation No. 04A-0006-2022-LW-2

NAME OF CLIENT: CARMONA WATER DISTRICT

RLA No.: ML 003195

Date : February 5, 2020

SAMPLE DESCRIPTION: Raw Water (Dolores Desuyo)
Submitted By: Carmona Water District
Date Received: January 30, 2020
Date of Sampling: January 30, 2020
Time of Sampling: 10:05 AM
Place of Sampling: CWD D-Line 11653 Torres St., Mabuhay, Carmona, Cavite
Source of Sampling: Water District
CCWD01G

Test Requested	Methodology	No. of Positive Tubes (out of five tubes)	Results MPN/100 ml	Standards MPN/100 ml
Total Coliform	Multiple Tube Fermentation	0	less than 1.1	less than 1.1
Thermotolerant Coliform (E. Coli)	Multiple Tube Fermentation	0	less than 1.1	less than 1.1

Test Requested	Description	Methodology	Results CFU/ml	Standards CFU/ ml
Heterotrophic Plate Count	Total Microbial Load	Pour Plate Method	356	less than 500

Note: The methodology used for coliform detection is the Multiple Tube Fermentation Technique as required by the Department of Health. The Heterotrophic Plate Count or the Total Microbial Load is being determined using the Pour Plate Method. The HPC is required in determining water potability (PNSDW 2017)

REMARKS:

The results showed that the water sample submitted PASSED the DOH standard for drinking water. Results are those obtained at time of examination and relate only to the sample/s tested.

REFERENCES:

Philippine National Standards for Drinking Water, 2017, Department of Health
Standard Methods for the Examination of Drinking Water and Wastewater
20th Edition, APHA, Washington, DC, 2005

Certified by :

Maricel S. Palogan, RMT
Laboratory Microbiologist
PRC Reg. No. 39410
WMLA-19-1008

Approved by:

Engr. Carlos B. Castromayor
Laboratory Manager
PRC Reg. No 18428


Noted by:

Engr. Ali M. Villamor
General Manager
PRC Reg. No. 53000



Like us on
Facebook

[@cosmolablaboratoriesinc](http://www.cosmolab-laboratories)



COSMOLAB LABORATORIES, INC.

"Caring for the Environment through Quality Testing"



MICROBIOLOGICAL TEST RESULTS for DRINKING WATER

DOH Water Laboratory Accreditation No. 04A-0006-2022-LW-2

NAME OF CLIENT: CARMONA WATER DISTRICT

RLA No.: ML 003195

Date : February 5, 2020

SAMPLE DESCRIPTION: Raw Water (Celia Montoya)
Submitted By: Carmona Water District
Date Received: January 30, 2020
Date of Sampling: January 30, 2020
Time of Sampling: 10:15 AM
Place of Sampling: D-Line Milagrosa Homes, Carmona, Cavite
Source of Sampling: Water District
CCWD01G

Test Requested	Methodology	No. of Positive Tubes (out of five tubes)	Results MPN/100 ml	Standards MPN/100 ml
Total Coliform	Multiple Tube Fermentation	0	less than 1.1	less than 1.1
Thermotolerant Coliform (E. Coli)	Multiple Tube Fermentation	0	less than 1.1	less than 1.1

Test Requested	Description	Methodology	Results CFU/ml	Standards CFU/ ml
Heterotrophic Plate Count	Total Microbial Load	Pour Plate Method	88	less than 500

Note: The methodology used for coliform detection is the Multiple Tube Fermentation Technique as required by the Department of Health. The Heterotrophic Plate Count or the Total Microbial Load is being determined using the Pour Plate Method. The HPC is required in determining water potability (PNSDW 2017)

REMARKS:

The results showed that the water sample submitted PASSED the DOH standard for drinking water. Results are those obtained at time of examination and relate only to the sample/s tested.

REFERENCES:

Philippine National Standards for Drinking Water, 2017, Department of Health
Standard Methods for the Examination of Drinking Water and Wastewater
20th Edition, APHA, Washington, DC, 2005

Certified by :

Maricel S. Palogan, RMT
Laboratory Microbiologist
PRC Reg. No. 39410
WMLA-19-1008

Approved by:

Engr. Carlos B. Castromayor
Laboratory Manager
PRC Reg. No 18428


Noted by:

Engr. Ali M. Villamor
General Manager
PRC Reg. No. 53000



Like us on
Facebook

[@cosmolablaboratoriesinc](http://www.cosmolab-laboratories)



COSMOLAB LABORATORIES, INC.

"Caring for the Environment through Quality Testing"

VGC
Group

MICROBIOLOGICAL TEST RESULTS for DRINKING WATER DOH Water Laboratory Accreditation No. 04A-0006-2022-LW-2

NAME OF CLIENT: CARMONA WATER DISTRICT

RLA No.: ML 003195

Date : February 5, 2020

SAMPLE DESCRIPTION: Raw Water (Joan Durano)
Submitted By: Carmona Water District
Date Received: January 30, 2020
Date of Sampling: January 30, 2020
Time of Sampling: 9:25 AM
Place of Sampling: Blk.22 Lt.17 Monte Carlo Brgy., Bancal, Carmona, Cavite
Source of Sampling: Water District
CCWD01G

Test Requested	Methodology	No. of Positive Tubes (out of five tubes)	Results	Standards
Total Coliform	Multiple Tube Fermentation	0	less than 1.1	less than 1.1
Thermotolerant Coliform (E.Coli)	Multiple Tube Fermentation	0	less than 1.1	less than 1.1

Test Requested	Description	Methodology	Results	Standards
Heterotrophic Plate Count	Total Microbial Load	Pour Plate Method	155	less than 500

Note: The methodology used for coliform detection is the Multiple Tube Fermentation Technique as required by the Department of Health. The Heterotrophic Plate Count or the Total Microbial Load is being determined using the Pour Plate Method. The HPC is required in determining water potability (PNSDW 2017)

REMARKS:

The results showed that the water sample submitted **PASSED** the DOH standard for drinking water. Results are those obtained at time of examination and relate only to the sample/s tested.

REFERENCES:

Philippine National Standards for Drinking Water, 2017, Department of Health
Standard Methods for the Examination of Drinking Water and Wastewater
20th Edition, APHA, Washington, DC, 2005

Certified by :

Maribel S. Palagan, RMT
Laboratory Microbiologist
PRC Reg. No. 39410
WMLA-19-1008

Approved by:

Engr. Carlos B. Castromayor
Laboratory Manager
PRC Reg. No 18428


Noted by:

Engr. Ali M. Villamor
General Manager
PRC Reg. No. 53000



Like us on
Facebook

[@cosmolablaboratoriesinc](http://www.cosmolab-laboratories)



COSMOLAB LABORATORIES, INC.

"Caring for the Environment through Quality Testing"



MICROBIOLOGICAL TEST RESULTS for DRINKING WATER

DOH Water Laboratory Accreditation No. 04A-0006-2022-LW-2

NAME OF CLIENT: CARMONA WATER DISTRICT

RLA No.: ML 003195

Date: February 5, 2020

SAMPLE DESCRIPTION: Raw Water (Francisco Pagsisiron)

Submitted By: Carmona Water District

Date Received: January 30, 2020

Date of Sampling: January 30, 2020

Time of Sampling: 8:51 AM

Place of Sampling: CWD D-Line 10348 San Pablo St., Kanluran, Brgy., Cabilang Baybay, Carmona, Cavite

Source of Sampling: Water District

Test Requested	Methodology	No. of Positive Tubes (out of five tubes)	Results	Standards
Total Coliform	Multiple Tube Fermentation	0	less than 1.1	less than 1.1
Thermotolerant Coliform (E. Coli)	Multiple Tube Fermentation	0	less than 1.1	less than 1.1

Test Requested	Description	Methodology	Results	Standards
Heterotrophic Plate Count	Total Microbial Load	Pour Plate Method	50	less than 500

Note: The methodology used for coliform detection is the Multiple Tube Fermentation Technique as required by the Department of Health. The Heterotrophic Plate Count or the Total Microbial Load is being determined using the Pour Plate Method. The HPC is required in determining water potability (PNSDW 2017)

REMARKS:

*The results showed that the water sample submitted **PASSED** the DOH standard for drinking water.*

Results are those obtained at time of examination and relate only to the sample/s tested.

REFERENCES:

Philippine National Standards for Drinking Water, 2017, Department of Health

Standard Methods for the Examination of Drinking Water and Wastewater

20th Edition, APHA, Washington, DC, 2005

Certified by:

Maricel S. Palagan, RMT
Laboratory Microbiologist
PRC Reg. No. 39410
WMLA-19-1008

Approved by:

Engr. Carlos B. Castromayor
Laboratory Manager
PRC Reg. No. 18428

Noted by:

Engr. Ali M. Villamor
General Manager
PRC Reg. No. 53000



Like us on
Facebook

[@cosmolablaboratoriesinc](http://www.cosmolab-laboratories)



COSMOLAB LABORATORIES, INC.

"Caring for the Environment through Quality Testing"



MICROBIOLOGICAL TEST RESULTS for DRINKING WATER

DOH Water Laboratory Accreditation No. 04A-0006-2022-LW-2

NAME OF CLIENT: CARMONA WATER DISTRICT

RLA No.: ML 003195

Date: February 5, 2020

SAMPLE DESCRIPTION: Raw Water (Conrado De Guzman)
Submitted By: Carmona Water District
Date Received: January 30, 2020
Date of Sampling: January 30, 2020
Time of Sampling: 9:53 AM
Place of Sampling: CWD D-Line San Jose St., Brgy. 2, Carmona, Cavite
Source of Sampling: Water District
CCWD01G

Test Requested	Methodology	No. of Positive Tubes (out of five tubes)	Results	Standards
Total Coliform	Multiple Tube Fermentation	0	less than 1.1	less than 1.1
Thermotolerant Coliform (E. Coli)	Multiple Tube Fermentation	0	less than 1.1	less than 1.1

Test Requested	Description	Methodology	Results	Standards
Heterotrophic Plate Count	Total Microbial Load	Pour Plate Method	30	less than 500

Note: The methodology used for coliform detection is the Multiple Tube Fermentation Technique as required by the Department of Health. The Heterotrophic Plate Count or the Total Microbial Load is being determined using the Pour Plate Method. The HPC is required in determining water potability (PNSDW 2017)

REMARKS:


The results showed that the water sample submitted **PASSED** the DOH standard for drinking water.

Results are those obtained at time of examination and relate only to the sample/s tested.


REFERENCES:

Philippine National Standards for Drinking Water, 2017, Department of Health
Standard Methods for the Examination of Drinking Water and Wastewater
20th Edition, APHA, Washington, DC, 2005


Certified by:


Maricel S. Palogan, RMT
Laboratory Microbiologist
PRC Reg. No. 39410
WMLA-19-1008

Approved by:


Engr. Carlos B. Castromayor
Laboratory Manager
PRC Reg. No 18428

Noted by:

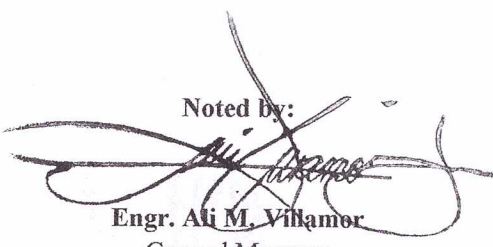
Engr. Ali M. Villamor
General Manager
PRC Reg. No. 53000



Like us on
Facebook

[@cosmolablaboratoriesinc](http://www.cosmolab-laboratories)



COSMOLAB LABORATORIES, INC.

"Caring for the Environment through Quality Testing"

VGC
Group

MICROBIOLOGICAL TEST RESULTS for DRINKING WATER DOH Water Laboratory Accreditation No. 04A-0006-2022-LW-2

NAME OF CLIENT: CARMONA WATER DISTRICT

SAMPLE DESCRIPTION: Raw Water (Helen Lee)
Submitted By: Carmona Water District
Date Received: January 30, 2020
Date of Sampling: January 30, 2020
Time of Sampling: 1:40 AM
Place of Sampling: CWD D-Line, Paseo de Carmona, Carmona, Cavite
Source of Sampling: Water District
CCWD01G

RLA No.: ML 003195
Date : February 5, 2020

Test Requested	Methodology	No. of Positive Tubes (out of five tubes)	Results MPN/100 ml	Standards MPN/100 ml
Total Coliform	Multiple Tube Fermentation	0	less than 1.1	less than 1.1
Thermotolerant Coliform (E. Coli)	Multiple Tube Fermentation	0	less than 1.1	less than 1.1

Test Requested	Description	Methodology	Results CFU/ml	Standards CFU/ ml
Heterotrophic Plate Count	Total Microbial Load	Pour Plate Method	68	less than 500

Note: The methodology used for coliform detection is the Multiple Tube Fermentation Technique as required by the Department of Health. The Heterotrophic Plate Count or the Total Microbial Load is being determined using the Pour Plate Method. The HPC is required in determining water potability (PNSDW 2017)

REMARKS:

The results showed that the water sample submitted PASSED the DOH standard for drinking water. Results are those obtained at time of examination and relate only to the sample/s tested.

REFERENCES:

Philippine National Standards for Drinking Water, 2017, Department of Health
Standard Methods for the Examination of Drinking Water and Wastewater
20th Edition, APHA, Washington, DC, 2005

Certified by :

Maricel S. Palagan, RMT
Laboratory Microbiologist
PRC Reg. No. 39410
WMLA-19-1008

Approved by:

Engr. Carlos B. Castromayor
Laboratory Manager
PRC Reg. No 18428


Noted by:

Engr. Ali M. Villamor
General Manager
PRC Reg. No. 53000



Like us on
Facebook

[@cosmolablaboratoriesinc](http://www.cosmolab-laboratories)



COSMOLAB LABORATORIES, INC.

"Caring for the Environment through Quality Testing"



MICROBIOLOGICAL TEST RESULTS for DRINKING WATER

DOH Water Laboratory Accreditation No. 04A-0006-2022-LW-2

NAME OF CLIENT: CARMONA WATER DISTRICT

SAMPLE DESCRIPTION: Raw Water (Lucia Florez)

Submitted By: Carmona Water District

Date Received: January 30, 2020

Date of Sampling: January 30, 2020

Time of Sampling: 8:56 AM

Place of Sampling: CWD D-Line Corehouse, Bancal, Carmona, Cavite

Source of Sampling: Water District

RLA No.: ML 003195
Date : February 5, 2020

Test Requested	Methodology	No. of Positive Tubes (out of five tubes)	Results	Standards
Total Coliform	Multiple Tube Fermentation	0	less than 1.1	less than 1.1
Thermotolerant Coliform (E. Coli)	Multiple Tube Fermentation	0	less than 1.1	less than 1.1

Test Requested	Description	Methodology	Results	Standards
Heterotrophic Plate Count	Total Microbial Load	Pour Plate Method	70	less than 500

Note: The methodology used for coliform detection is the Multiple Tube Fermentation Technique as required by the Department of Health. The Heterotrophic Plate Count or the Total Microbial Load is being determined using the Pour Plate Method. The HPC is required in determining water potability (PNSDW 2017)

REMARKS:

The results showed that the water sample submitted PASSED the DOH standard for drinking water. Results are those obtained at time of examination and relate only to the sample/s tested.

REFERENCES:

Philippine National Standards for Drinking Water, 2017, Department of Health
Standard Methods for the Examination of Drinking Water and Wastewater
20th Edition, APHA, Washington, DC, 2005

Certified by :

Maricel S. Palogan, RMT
Laboratory Microbiologist
PRC Reg. No. 39410
WMLA-19-1008

Approved by:

Engr. Carlos B. Castromayor
Laboratory Manager
PRC Reg. No 18428


Noted by:

Engr. Ali M. Villamor
General Manager
PRC Reg. No. 53000



Like us on
Facebook

<http://www.cosmolab-laboratories.com>
@cosmolablaboratoriesinc



COSMOLAB LABORATORIES, INC.

"Caring for the Environment through Quality Testing"



MICROBIOLOGICAL TEST RESULTS for DRINKING WATER

DOH Water Laboratory Accreditation No. 04A-0006-2022-LW-2

NAME OF CLIENT: CARMONA WATER DISTRICT

RLA No.: ML 003195

Date : February 5, 2020

SAMPLE DESCRIPTION: Raw Water (Ruffo Arange)
Submitted By: Carmona Water District
Date Received: January 30, 2020
Date of Sampling: January 30, 2020
Time of Sampling: 9:42 AM
Place of Sampling: D-Line Phase 4 Milagrosa, Carmona, Cavite
Source of Sampling: Water District
CCWD01G

Test Requested	Methodology	No. of Positive Tubes (out of five tubes)	Results	Standards
Total Coliform	Multiple Tube Fermentation	0	less than 1.1	less than 1.1
Thermotolerant Coliform (E. Coli)	Multiple Tube Fermentation	0	less than 1.1	less than 1.1

Test Requested	Description	Methodology	Results	Standards
Heterotrophic Plate Count	Total Microbial Load	Pour Plate Method	25	less than 500

Note: The methodology used for coliform detection is the Multiple Tube Fermentation Technique as required by the Department of Health. The Heterotrophic Plate Count or the Total Microbial Load is being determined using the Pour Plate Method. The HPC is required in determining water potability (PNSDW 2017)


REMARKS:

The results showed that the water sample submitted PASSED the DOH standard for drinking water. Results are those obtained at time of examination and relate only to the sample/s tested.


REFERENCES:

Philippine National Standards for Drinking Water, 2017, Department of Health
Standard Methods for the Examination of Drinking Water and Wastewater
20th Edition, APHA, Washington, DC, 2005


Certified by :


Mariel S. Palogan, RMT
Laboratory Microbiologist
PRC Reg. No. 39410
WMLA-19-1008

Approved by:


Engr. Carlos B. Castromayor
Laboratory Manager
PRC Reg. No 18428


Noted by:

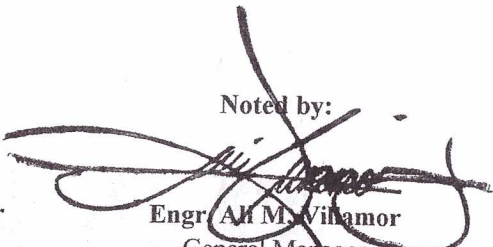
Engr. Ali M. Villamor
General Manager
PRC Reg. No. 53000



Like us on
Facebook

[@cosmolablaboratoriesinc](http://www.cosmolab-laboratories)



COSMOLAB LABORATORIES, INC.

"Caring for the Environment through Quality Testing"



MICROBIOLOGICAL TEST RESULTS for DRINKING WATER

DOH Water Laboratory Accreditation No. 04A-0006-2022-LW-2

NAME OF CLIENT: CARMONA WATER DISTRICT

RLA No.: ML 003195

Date : February 5, 2020

SAMPLE DESCRIPTION: Raw Water (Josephine Javier)
Submitted By: Carmona Water District
Date Received: January 31, 2020
Date of Sampling: January 31, 2020
Time of Sampling: 9:55 AM
Place of Sampling: Kubkob, Brgy., Mabuhay, Carmona, Cavite
Source of Sampling: Water District

Test Requested	Methodology	No. of Positive Tubes (out of five tubes)	Results MPN/100 ml	Standards MPN/100 ml
Total Coliform	Multiple Tube Fermentation	0	less than 1.1	less than 1.1
Thermotolerant Coliform (E. Coli)	Multiple Tube Fermentation	0	less than 1.1	less than 1.1

Test Requested	Description	Methodology	Results CFU/ml	Standards CFU/ ml
Heterotrophic Plate Count	Total Microbial Load	Pour Plate Method	115	less than 500

Note: The methodology used for coliform detection is the Multiple Tube Fermentation Technique as required by the Department of Health. The Heterotrophic Plate Count or the Total Microbial Load is being determined using the Pour Plate Method. The HPC is required in determining water potability (PNSDW 2017)

REMARKS:

The results showed that the water sample submitted PASSED the DOH standard for drinking water. Results are those obtained at time of examination and relate only to the sample/s tested.

REFERENCES:

Philippine National Standards for Drinking Water, 2017, Department of Health
Standard Methods for the Examination of Drinking Water and Wastewater
20th Edition, APHA, Washington, DC, 2005

Certified by :

Maricel S. Palagan, RMT
Laboratory Microbiologist
PRC Reg. No. 39410
WMLA-19-1008


Approved by:

Engr. Carlos B. Castromayor
Laboratory Manager
PRC Reg. No 18428

Noted by:

Engr. Ali M. Villamor
General Manager
PRC Reg. No. 53000





COSMOLAB LABORATORIES, INC.

"Caring for the Environment through Quality Testing"



MICROBIOLOGICAL TEST RESULTS for DRINKING WATER

DOH Water Laboratory Accreditation No. 04A-0006-2022-LW-2

NAME OF CLIENT: CARMONA WATER DISTRICT

RLA No.: ML 003195

Date : February 5, 2020

SAMPLE DESCRIPTION: Raw Water (Paul Reyes)
Submitted By: Carmona Water District
Date Received: January 30, 2020
Date of Sampling: January 30, 2020
Time of Sampling: 9:18 AM
Place of Sampling: Blk. 1 Lt. 4 Monte Carlo Brgy., Bancal, Carmona, Cavite
Source of Sampling: Water District
CCWD01G

Test Requested	Methodology	No. of Positive Tubes (out of five tubes)	Results	Standards
Total Coliform	Multiple Tube Fermentation	0	less than 1.1	less than 1.1
Thermotolerant Coliform (E.Coli)	Multiple Tube Fermentation	0	less than 1.1	less than 1.1

Test Requested	Description	Methodology	Results	Standards
Heterotrophic Plate Count	Total Microbial Load	Pour Plate Method	46	less than 500

Note: The methodology used for coliform detection is the Multiple Tube Fermentation Technique as required by the Department of Health. The Heterotrophic Plate Count or the Total Microbial Load is being determined using the Pour Plate Method. The HPC is required in determining water potability (PNSDW 2017)


REMARKS:

The results showed that the water sample submitted PASSED the DOH standard for drinking water. Results are those obtained at time of examination and relate only to the sample/s tested.


REFERENCES:

Philippine National Standards for Drinking Water, 2017, Department of Health
Standard Methods for the Examination of Drinking Water and Wastewater
20th Edition, APHA, Washington, DC, 2005


Certified by :


Maricel S. Palogan, RMT
Laboratory Microbiologist
PRC Reg. No. 39410
WMLA-19-1008

Approved by:


Engr. Carlos B. Castromayor
Laboratory Manager
PRC Reg. No 18428


Noted by:

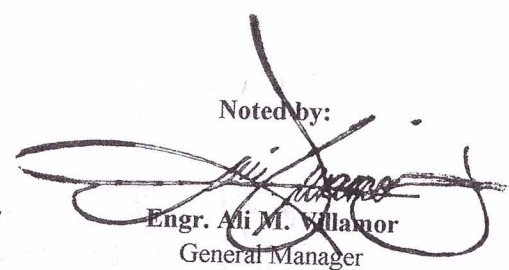
Engr. Ali M. Villamor
General Manager
PRC Reg. No. 53000



Like us on
Facebook

[@cosmolablaboratoriesinc](http://www.cosmolab-laboratories)



COSMOLAB LABORATORIES, INC.

"Caring for the Environment through Quality Testing"



MICROBIOLOGICAL TEST RESULTS for DRINKING WATER

DOH Water Laboratory Accreditation No. 04A-0006-2022-LW-2

NAME OF CLIENT: CARMONA WATER DISTRICT

RLA No.: ML 003195

Date : February 5, 2020

SAMPLE DESCRIPTION: Raw Water (Ferdinand Tarok)
Submitted By: Carmona Water District
Date Received: January 30, 2020
Date of Sampling: January 30, 2020.
Time of Sampling: 9:05 AM
Place of Sampling: CWD D-Line 8221 Konsehal St., Brgy., 8, Carmona, Cavite
Source of Sampling: Water District

Test Requested	Methodology	No. of Positive Tubes (out of five tubes)	Results MPN/100 ml	Standards MPN/100 ml
Total Coliform	Multiple Tube Fermentation	0	less than 1.1	less than 1.1
Thermotolerant Coliform (E. Coli)	Multiple Tube Fermentation	0	less than 1.1	less than 1.1

Test Requested	Description	Methodology	Results CFU/ml	Standards CFU/ ml
Heterotrophic Plate Count	Total Microbial Load	Pour Plate Method	67	less than 500

Note: The methodology used for coliform detection is the Multiple Tube Fermentation Technique as required by the Department of Health. The Heterotrophic Plate Count or the Total Microbial Load is being determined using the Pour Plate Method. The HPC is required in determining water potability (PNSDW 2017)

REMARKS:

The results showed that the water sample submitted PASSED the DOH standard for drinking water.

Results are those obtained at time of examination and relate only to the sample/s tested.

REFERENCES:

Philippine National Standards for Drinking Water, 2017, Department of Health
Standard Methods for the Examination of Drinking Water and Wastewater
20th Edition, APHA, Washington, DC, 2005

Certified by :

Maricel S. Palagan, RMT
Laboratory Microbiologist
PRC Reg. No. 39410
WMLA-19-1008

Approved by:

Engr. Carlos B. Castromayor
Laboratory Manager
PRC Reg. No 18428


Noted by:

Engr. Ali M. Villamor
General Manager
PRC Reg. No. 53000



Like us on
Facebook

[@cosmolablaboratoriesinc](http://www.cosmolab-laboratories)



COSMOLAB LABORATORIES, INC.

"Caring for the Environment through Quality Testing"



MICROBIOLOGICAL TEST RESULTS for DRINKING WATER DOH Water Laboratory Accreditation No. 04A-0006-2022-LW-2

NAME OF CLIENT: CARMONA WATER DISTRICT

RLA No.: ML 003195

Date : February 5, 2020

SAMPLE DESCRIPTION: Raw Water (Josefina R. Reyes)
Submitted By: Carmona Water District
Date Received: January 30, 2020
Date of Sampling: January 30, 2020
Time of Sampling: 9:25 AM
Place of Sampling: CWD D-Line 1186 San Pablo St., Brgy., 1, Carmona, Cavite
Source of Sampling: Water District
CWD/DLG

Test Requested	Methodology	No. of Positive Tubes (out of five tubes)	Results	Standards
Total Coliform	Multiple Tube Fermentation	0	less than 1.1	less than 1.1
Thermotolerant Coliform (E. Coli)	Multiple Tube Fermentation	0	less than 1.1	less than 1.1

Test Requested	Description	Methodology	Results	Standards
Heterotrophic Plate Count	Total Microbial Load	Pour Plate Method	38	less than 500

Note: The methodology used for coliform detection is the Multiple Tube Fermentation Technique as required by the Department of Health. The Heterotrophic Plate Count or the Total Microbial Load is being determined using the Pour Plate Method. The HPC is required in determining water potability (PNSDW 2017)

REMARKS:

The results showed that the water sample submitted PASSED the DOH standard for drinking water. Results are those obtained at time of examination and relate only to the sample/s tested.

REFERENCES:

Philippine National Standards for Drinking Water, 2017, Department of Health
Standard Methods for the Examination of Drinking Water and Wastewater
20th Edition, APHA, Washington, DC, 2005

Certified by :

Maricel S. Pafogan, RMT
Laboratory Microbiologist
PRC Reg. No. 39410
WMLA-19-1008

Approved by:

Engr. Carlos B. Castromayor
Laboratory Manager
PRC Reg. No 18428

Noted by:

Engr. Ali M. Villamor
General Manager
PRC Reg. No. 53000



Like us on
Facebook

[@cosmolablaboratoriesinc](http://www.cosmolab-laboratories)



COSMOLAB LABORATORIES, INC.

"Caring for the Environment through Quality Testing"



MICROBIOLOGICAL TEST RESULTS for DRINKING WATER

DOH Water Laboratory Accreditation No. 04A-0006-2022-LW-2

NAME OF CLIENT: CARMONA WATER DISTRICT

RLA No.: ML 003195

Date : February 5, 2020

SAMPLE DESCRIPTION: Raw Water (Lea Areiaga)
Submitted By: Carmona Water District
Date Received: January 30, 2020
Date of Sampling: January 30, 2020
Time of Sampling: 10:30 AM
Place of Sampling: CWD D-Line Phase 2, Brgy., Milagrosa, Carmona, Cavite
Source of Sampling: Water District
CCWD01G

Test Requested	Methodology	No. of Positive Tubes (out of five tubes)	Results MPN/100 ml	Standards MPN/100 ml
Total Coliform	Multiple Tube Fermentation	0	less than 1.1	less than 1.1
Thermotolerant Coliform (E. Coli)	Multiple Tube Fermentation	0	less than 1.1	less than 1.1

Test Requested	Description	Methodology	Results CFU/ml	Standards CFU/ ml
Heterotrophic Plate Count	Total Microbial Load	Pour Plate Method	42	less than 500

Note: The methodology used for coliform detection is the Multiple Tube Fermentation Technique as required by the Department of Health. The Heterotrophic Plate Count or the Total Microbial Load is being determined using the Pour Plate Method. The HPC is required in determining water potability (PNSDW 2017)


REMARKS:

The results showed that the water sample submitted PASSED the DOH standard for drinking water. Results are those obtained at time of examination and relate only to the sample/s tested.


REFERENCES:

Philippine National Standards for Drinking Water, 2017, Department of Health
Standard Methods for the Examination of Drinking Water and Wastewater
20th Edition, APHA, Washington, DC, 2005


Certified by :


Maricela S. Palagan, RMT
Laboratory Microbiologist
PRC Reg. No. 39410
WMLA-19-1008

Approved by:


Engr. Carlos B. Castromayor
Laboratory Manager
PRC Reg. No 18428


Noted by:

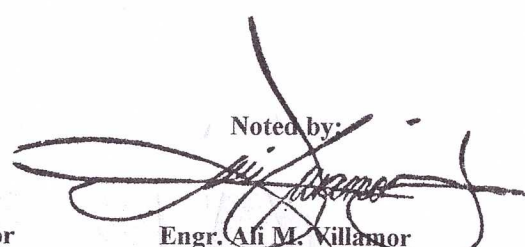
Engr. Ali M. Villamor
General Manager
PRC Reg. No. 53000



Like us on
Facebook

[@cosmolablaboratoriesinc](http://www.cosmolab-laboratories)



COSMOLAB LABORATORIES, INC.

"Caring for the Environment through Quality Testing"



MICROBIOLOGICAL TEST RESULTS for DRINKING WATER

DOH Water Laboratory Accreditation No. 04A-0006-2022-LW-2

NAME OF CLIENT: CARMONA WATER DISTRICT

RLA No.: ML 003195

Date : February 5, 2020

SAMPLE DESCRIPTION: Raw Water (Nelia Delos Santos)

Submitted By: Carmona Water District

Date Received: January 30, 2020

Date of Sampling: January 30, 2020

Time of Sampling: 9:08 AM

Place of Sampling: Abubot St., Brgy., Bancal, Carmona, Cavite

Source of Sampling: Water District

CCWD01G

Test Requested	Methodology	No. of Positive Tubes (out of five tubes)	Results	Standards
Total Coliform	Multiple Tube Fermentation	0	MPN/100 ml less than 1.1	MPN/100 ml less than 1.1
Thermotolerant Coliform (E.Coli)	Multiple Tube Fermentation	0	less than 1.1	less than 1.1

Test Requested	Description	Methodology	Results	Standards
Heterotrophic Plate Count	Total Microbial Load	Pour Plate Method	CFU/ml 71	CFU/ ml less than 500

Note: The methodology used for coliform detection is the Multiple Tube Fermentation Technique as required by the Department of Health. The Heterotrophic Plate Count or the Total Microbial Load is being determined using the Pour Plate Method. The HPC is required in determining water potability (PNSDW 2017)

REMARKS:

The results showed that the water sample submitted PASSED the DOH standard for drinking water.

Results are those obtained at time of examination and relate only to the sample/s tested.

REFERENCES:

Philippine National Standards for Drinking Water, 2017, Department of Health
Standard Methods for the Examination of Drinking Water and Wastewater
20th Edition, APHA, Washington, DC, 2005

Certified by :

Marice S. Palogan, RMT
Laboratory Microbiologist
PRC Reg. No. 39410
WMLA-19-1008

Approved by:

Engr. Carlos B. Castromayor
Laboratory Manager
PRC Reg. No 18428

Noted by:

Engr. Ali M. Villamor
General Manager
PRC Reg. No. 53000



Like us on
Facebook

[@cosmolablaboratoriesinc](http://www.cosmolab-laboratories)