

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

CARMONA WATER DISTRICT WATER REFILLING STATION
BLOCK 8 LOT 8, JOY ST. CITYLAND SUBD., BRGY. MABUHAY
CARMONA, CAVITE

Certificate No.: **24006192ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0454**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/4/2024 9:45AM**
Collected By: **H. MEDINA**

Sampling Point: **FAUCET**
Type of Water: **PURIFIED**
Date/Time Received: **4/4/2024 3:49PM**
Date/Time Tested: **4/4/2024 4:00PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS
NOTHING FOLLOWS				


Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEVWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.


CHLOE JOY C. GABAN, RMicro
Senior Microbiologist
PAM Reg. No. 15-00250 RM
DOH-NRL Cert. No. WMLA-18-0698




PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

LAT SOLHERM
BLK 4 LOT 34 CITY LAND
CARMONA, CAVITE

Certificate No.: **24006193ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0455**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/4/2024 9:55AM**
Collected By: **H. MEDINA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/4/2024 3:49PM**
Date/Time Tested: **4/4/2024 4:00PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS


PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS


NOTHING FOLLOWS


Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.




CHLOE JOY C. GABAN, RMicro
Senior Microbiologist
PAM Reg. No. 15-00250 RM
DOH-NRL Cert. No. WMLA-18-0698


PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

MORTERA RICHARD
11223 MABUHAY
CARMONA, CAVITE

Certificate No.: **24006194ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0456**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/4/2024 10:01AM**
Collected By: **H. MEDINA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/4/2024 3:49PM**
Date/Time Tested: **4/4/2024 4:00PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



CHLOE JOY C. GABAN, RMicro
Senior Microbiologist
PAM Reg. No. 15-00250 RM
DOH-NRL Cert. No. WMLA-18-0698

PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

BARANGAY II OUTPOST
BRGY. II
CARMONA, CAVITE

Certificate No.: **24006195ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0457**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/4/2024 10:09AM**
Collected By: **H. MEDINA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/4/2024 3:49PM**
Date/Time Tested: **4/4/2024 4:00PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS


PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.


Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.


CHLOE JOY C. GABAN, RMicro
Senior Microbiologist
PAM Reg. No. 15-00250 RM
DOH-NRL Cert. No. WMLA-18-0698
PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927



AQUALABPH
Integrity in Every Result®



Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

RAMOS AZON
11600 PURIFICATION ST. MABUHAY
CARMONA, CAVITE

Certificate No.: **24006196ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0458**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/4/2024 10:17AM**
Collected By: **H. MEDINA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/4/2024 3:49PM**
Date/Time Tested: **4/4/2024 4:00PM**


CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS
NOTHING FOLLOWS				

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



CHLOE JOY C. GABAN, RMicro
Senior Microbiologist
PAM Reg. No. 15-00250 RM
DOH-NRL Cert. No. WMLA-18-0698



PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

TRAJANO LORETA C.
1.63-64 MILAGROSA HOMES MILAGROSA
CARMONA, CAVITE

Certificate No.: **24006197ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0459**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/4/2024 10:27AM**
Collected By: **H. MEDINA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/4/2024 3:49PM**
Date/Time Tested: **4/4/2024 4:00PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS


Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



CHLOE JOY C. GABAN, RMicro
Senior Microbiologist
PAM Reg. No. 15-00250 RM
DOH-NRL Cert. No. WMLA-18-0698



PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

LONTOC JAY-P A.
1168 SAN PABLO ST. BRGY. I
CARMONA, CAVITE

Certificate No.: **24006198ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0460**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/4/2024 10:40AM**
Collected By: **H. MEDINA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/4/2024 3:49PM**
Date/Time Tested: **4/4/2024 4:00PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS



PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS


Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



CHLOE JOY C. GABAN, RMicro
Senior Microbiologist
PAM Reg. No. 15-00250 RM
DOH-NRL Cert. No. WMLA-18-0698



PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

LOYOLA MAYNARD
10109 SAN PABLO ST.
CARMONA, CAVITE

Certificate No.: **24006199ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0461**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/4/2024 10:50AM**
Collected By: **H. MEDINA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/4/2024 3:49PM**
Date/Time Tested: **4/4/2024 4:00PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS


PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS


Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



CHLOE JOY C. GABAN, RMicro
Senior Microbiologist
PAM Reg. No. 15-00250 RM
DOH-NRL Cert. No. WMLA-18-0698



PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

CAPUNITAN MARCELO
SAN PABLO ST. BRGY. 10
CARMONA, CAVITE

Certificate No.: **24006200ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0462**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/4/2024 11:00AM**
Collected By: **H. MEDINA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/4/2024 3:49PM**
Date/Time Tested: **4/4/2024 4:00PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS



PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.


CHLOE JOY C. GABAN, RMicro
Senior Microbiologist
PAM Reg. No. 15-00250 RM
DOH-NRL Cert. No. WMLA-18-0698
PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

BAYUGO ARLENE
8231 ROSARIO BRGY. 8
CARMONA, CAVITE

Certificate No.: **24006201ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0463**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/4/2024 11:10AM**
Collected By: **H. MEDINA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/4/2024 3:49PM**
Date/Time Tested: **4/4/2024 4:00PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS



PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.


CHLOE JOY C. GABAN, RMicro
Senior Microbiologist
PAM Reg. No. 15-00250 RM
DOH-NRL Cert. No. WMLA-18-0698
PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT © is a registered trademark of AQUALAB PH

EFREN ORTIZ
ROSARIO ST. BRGY. 8
CARMONA, CAVITE

Certificate No.: **24006202ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0464**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/4/2024 11:17AM**
Collected By: **H. MEDINA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/4/2024 3:49PM**
Date/Time Tested: **4/4/2024 4:00PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS


Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



CHLOE JOY C. GABAN, RMicro
Senior Microbiologist
PAM Reg. No. 15-00250 RM
DOH-NRL Cert. No. WMLA-18-0698



PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

CADINTE ARMANDO
901 BALANGAW ST. BRGY. MADUYA
CARMONA, CAVITE

Certificate No.: **24006203ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0465**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/4/2024 11:23AM**
Collected By: **H. MEDINA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/4/2024 3:49PM**
Date/Time Tested: **4/4/2024 4:00PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS




PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.


CHLOE JOY C. GABAN, RMicro
Senior Microbiologist
PAM Reg. No. 15-00250 RM
DOH-NRL Cert. No. WMLA-18-0698
PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

MANARIN REDANTE
BALANGAW ST. BRGY. MADUYA
CARMONA, CAVITE

Certificate No.: **24006204ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0466**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/4/2024 11:28AM**
Collected By: **H. MEDINA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/4/2024 3:49PM**
Date/Time Tested: **4/4/2024 4:00PM**


CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS
NOTHING FOLLOWS				


Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



CHLOE JOY C. GABAN, RMicro
Senior Microbiologist
PAM Reg. No. 15-00250 RM
DOH-NRL Cert. No. WMLA-18-0698



PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

LACSON RAQUEL G.

9262 CONRADO ST. ALTAREZ VILLAGE MADUYA
CARMONA, CAVITE

Certificate No.: **24006205ML**Account ID: **46CAR0223WSP001**Sample ID: **D0467**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/4/2024 11:39AM**
Collected By: **H. MEDINA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/4/2024 3:49PM**
Date/Time Tested: **4/4/2024 4:00PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

*****NOTHING FOLLOWS*****

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



CHLOE JOY C. GABAN, RMicro
Senior Microbiologist
PAM Reg. No. 15-00250 RM
DOH-NRL Cert. No. WMLA-18-0698



PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

MARIANO JOSELITO
BRGY. 13 LANTIC
CARMONA, CAVITE

Certificate No.: **24006206ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0468**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/4/2024 11:47AM**
Collected By: **H. MEDINA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/4/2024 3:49PM**
Date/Time Tested: **4/4/2024 4:00PM**



CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS
NOTHING FOLLOWS				



Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



CHLOE JOY C. GABAN, RMicro
Senior Microbiologist
PAM Reg. No. 15-00250 RM
DOH-NRL Cert. No. WMLA-18-0698



PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

ARIOLA DOREEN
BRGY. 13 LANTIC
CARMONA, CAVITE

Certificate No.: **24006207ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0469**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/4/2024 11:54AM**
Collected By: **H. MEDINA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/4/2024 3:49PM**
Date/Time Tested: **4/4/2024 4:00PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS



Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



CHLOE JOY C. GABAN, RMicro
Senior Microbiologist
PAM Reg. No. 15-00250 RM
DOH-NRL Cert. No. WMLA-18-0698



PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

JAVIER HERN ANDOG
COREHOUSE BANCAL
CARMONA, CAVITE

Certificate No.: **24006208ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0470**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/4/2024 12:49PM**
Collected By: **H. MEDINA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/4/2024 3:49PM**
Date/Time Tested: **4/4/2024 4:00PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS



Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



CHLOE JOY C. GABAN, RMicro
Senior Microbiologist
PAM Reg. No. 15-00250 RM
DOH-NRL Cert. No. WMLA-18-0698



PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

CUSTODIO JULIANA
14228 BANCAL CAMIAS RD.
CARMONA, CAVITE

Certificate No.: **24006209ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0471**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/4/2024 12:59PM**
Collected By: **H. MEDINA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/4/2024 3:49PM**
Date/Time Tested: **4/4/2024 4:00PM**




CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS
NOTHING FOLLOWS				


Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



CHLOE JOY C. GABAN, RMicro
Senior Microbiologist
PAM Reg. No. 15-00250 RM
DOH-NRL Cert. No. WMLA-18-0698



PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

BATINGAL ROLANDO
1419 BANCAL
CARMONA, CAVITE

Certificate No.: **24006210ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0472**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/4/2024 1:15AM**
Collected By: **H. MEDINA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/4/2024 3:49PM**
Date/Time Tested: **4/4/2024 4:00PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS
NOTHING FOLLOWS				


Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



CHLOE JOY C. GABAN, RMicro
Senior Microbiologist
PAM Reg. No. 15-00250 RM
DOH-NRL Cert. No. WMLA-18-0698

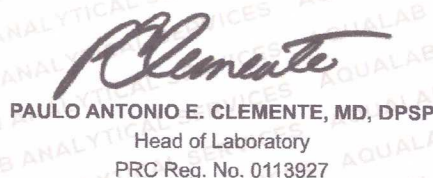

PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

PONCIANO MERCADO
ABANDON RD. BANCAL
CARMONA, CAVITE

Certificate No.: **24006211ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0473**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/4/2024 1:21AM**
Collected By: **H. MEDINA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/4/2024 3:49PM**
Date/Time Tested: **4/4/2024 4:00PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS



PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.


CHLOE JOY C. GABAN, RMicro
Senior Microbiologist
PAM Reg. No. 15-00250 RM
DOH-NRL Cert. No. WMLA-18-0698
PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT © is a registered trademark of AQUALAB PH

JOY HERARMAN
BLK 22 LOT 23 SUZUKI MONTE CARLO
CARMONA, CAVITE

Certificate No.: **24006212ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0474**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/4/2024 1:25AM**
Collected By: **H. MEDINA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/4/2024 3:49PM**
Date/Time Tested: **4/4/2024 4:00PM**


CERTIFICATE OF MICROBIOLOGICAL ANALYSIS


PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS
NOTHING FOLLOWS				


Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.




CHLOE JOY C. GABAN, RMicro
Senior Microbiologist
PAM Reg. No. 15-00250 RM
DOH-NRL Cert. No. WMLA-18-0698


PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927