



AQUALABPH
Integrity in Every Result.®

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT ® is a registered trademark of AQUALAB PH



Accredited Laboratory for Water Analysis
Accreditation No. 4A-0006-2224-LW-2

ERNESJOHN ESTRADA

BLK 4 LOT 17 PANCIL VILLA SORTEO
CARMONA, CAVITE

Certificate No.: **24018095ML**

Account ID: **46CAR0223WSP001**

Sample ID: **J0327**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **10/3/2024 9:11AM**
Collected By: **M. VILLA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **10/3/2024 3:26PM**
Date/Time Tested: **10/3/2024 3:39PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON
Microbiologist

DOH-NRL Cert. No. WMLA-18-0796



PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

FORBES EVELYN

BLK 1 LOT 4 PHASE 3 IN HALF MILAGROSA
CARMONA, CAVITE

Certificate No.: **24018096ML**

Account ID: **46CAR0223WSP001**

Sample ID: **J0328**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **10/3/2024 9:09AM**
Collected By: **M. VILLA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **10/3/2024 3:26PM**
Date/Time Tested: **10/3/2024 3:39PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON
Microbiologist

DOH-NRL Cert. No. WMLA-18-0796



PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

CORTEZ SUZAN

BLK 7 PHASE3 1/2 MILAGROSA
CARMONA, CAVITE

Certificate No.: **24018097ML**

Account ID: **46CAR0223WSP001**
Sample ID: **J0329**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **10/3/2024 9:27AM**
Collected By: **M. VILLA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **10/3/2024 3:26PM**
Date/Time Tested: **10/3/2024 3:39PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS


PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.


Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON
Microbiologist

DOH-NRL Cert. No. WMLA-18-0796



PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

OPEDA JESSIE
12500 PATINDIG ARAW MILAGROSA
CARMONA, CAVITE

Certificate No.: **24018098ML**
Account ID: **46CAR0223WSP001**
Sample ID: **J0330**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **10/3/2024 9:38AM**
Collected By: **M. VILLA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **10/3/2024 3:26PM**
Date/Time Tested: **10/3/2024 3:39PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON
Microbiologist

DOH-NRL Cert. No. WMLA-18-0796

PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

RENATO OSENA

BLK 14 LOT 11 PHASE 3 MILAGROSA
CARMONA, CAVITE

Certificate No.: **24018099ML**

Account ID: **46CAR0223WSP001**
Sample ID: **J0331**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **10/3/2024 9:45AM**
Collected By: **M. VILLA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **10/3/2024 3:26PM**
Date/Time Tested: **10/3/2024 3:39PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS


PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON
Microbiologist
DOH-NRL Cert. No. WMLA-18-0796

PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

ERLINDA HAPA
12743 PHASE 2 MILAGROSA
CARMONA, CAVITE

Certificate No.: **24018100ML**
Account ID: **46CAR0223WSP001**
Sample ID: **J0332**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **10/3/2024 9:53AM**
Collected By: **M. VILLA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **10/3/2024 3:26PM**
Date/Time Tested: **10/3/2024 3:39PM**


CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS
NOTHING FOLLOWS				

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.


Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON
Microbiologist

DOH-NRL Cert. No. WMLA-18-0796

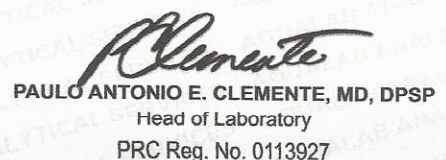

PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

HEBRON ERIBERTO
12902 PHASE 1 MILAGROSA
CARMONA, CAVITE

Certificate No.: **24018101ML**
Account ID: **46CAR0223WSP001**
Sample ID: **J0333**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **10/3/2024 10:01AM**
Collected By: **M. VILLA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **10/3/2024 3:26PM**
Date/Time Tested: **10/3/2024 3:39PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS


PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON
Microbiologist

DOH-NRL Cert. No. WMLA-18-0796



PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

DADIS M. CRISTINA

BLK 5 LOT 26 MILAGROSA HOMES
CARMONA, CAVITE

Certificate No.: **24018102ML**

Account ID: **46CAR0223WSP001**
Sample ID: **J0334**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **10/3/2024 10:09AM**
Collected By: **M. VILLA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **10/3/2024 3:26PM**
Date/Time Tested: **10/3/2024 3:39PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS


PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON
Microbiologist
DOH-NRL Cert. No. WMLA-18-0796



PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

FRERENCIO ATENDIDO
CALUMPANG RD. BRGY. LANTIC
CARMONA, CAVITE

Certificate No.: **24018104ML**
Account ID: **46CAR0223WSP001**
Sample ID: **J0336**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **10/3/2024 10:30AM**
Collected By: **M. VILLA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **10/3/2024 3:26PM**
Date/Time Tested: **10/3/2024 3:39PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS


PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.


Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON
Microbiologist

DOH-NRL Cert. No. WMLA-18-0796


PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

MA. CECILIA GALVEZ
ALTAREZ BRGY. MADUYA
CARMONA, CAVITE

Certificate No.: **24018105ML**
Account ID: **46CAR0223WSP001**
Sample ID: **J0337**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **10/3/2024 10:48AM**
Collected By: **M. VILLA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **10/3/2024 3:26PM**
Date/Time Tested: **10/3/2024 3:39PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample


Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON
Microbiologist

DOH-NRL Cert. No. WMLA-18-0796




PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

ABELARDO GIRON
8140 ROSARIO ST. BRGY. 8
CARMONA, CAVITE

Certificate No.: **24018106ML**
Account ID: **46CAR0223WSP001**
Sample ID: **J0338**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **10/3/2024 11:03AM**
Collected By: **M. VILLA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **10/3/2024 3:26PM**
Date/Time Tested: **10/3/2024 3:39PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON
Microbiologist

DOH-NRL Cert. No. WMLA-18-0796



PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

PLACIDA CLARIÑO
833 ROSARIO ST. BRGY. 8
CARMONA, CAVITE

Certificate No.: **24018107ML**
Account ID: **46CAR0223WSP001**
Sample ID: **J0339**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **10/3/2024 11:15AM**
Collected By: **M. VILLA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **10/3/2024 3:26PM**
Date/Time Tested: **10/3/2024 3:39PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS


PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON

Microbiologist

DOH-NRL Cert. No. WMLA-18-0796

PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

ORISANTOS AGNES

BLK 1 LOT 59 MAPALAD ST. MABUHAY
CARMONA, CAVITE

Certificate No.: **24018108ML**

Account ID: **46CAR0223WSP001**
Sample ID: **J0340**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **10/3/2024 11:29AM**
Collected By: **M. VILLA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **10/3/2024 3:26PM**
Date/Time Tested: **10/3/2024 3:39PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS


PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	1	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.


Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON
Microbiologist

DOH-NRL Cert. No. WMLA-18-0796

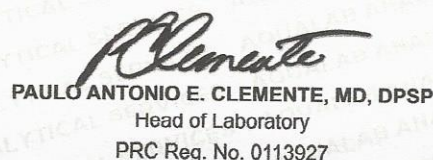

PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

MADRID ANASCO
SOUTH COAST BRGY. BANCAL
CARMONA, CAVITE

Certificate No.: **24018110ML**
Account ID: **46CAR0223WSP001**
Sample ID: **J0343**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **10/3/2024 1:20PM**
Collected By: **M. VILLA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **10/3/2024 3:26PM**
Date/Time Tested: **10/3/2024 3:39PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS


PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON

Microbiologist

DOH-NRL Cert. No. WMLA-18-0796



PAULO ANTONIO E. CLEMENTE, MD, DPSP

Head of Laboratory

PRC Reg. No. 0113927

LUCIANA DUMALAGAN
COREHOUSE BANCAL
CARMONA, CAVITE

Certificate No.: **24018111ML**
Account ID: **46CAR0223WSP001**
Sample ID: **J0344**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **10/3/2024 1:41PM**
Collected By: **M. VILLA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **10/3/2024 3:26PM**
Date/Time Tested: **10/3/2024 3:39PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS


PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS


Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEVWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON
Microbiologist
DOH-NRL Cert. No. WMLA-18-0796


PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

FLORENCIA BERIAGUEL
BANCAL ABANDON ROAD
CARMONA, CAVITE

Certificate No.: **24018112ML**
Account ID: **46CAR0223WSP001**
Sample ID: **J0345**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **10/3/2024 2:03PM**
Collected By: **M. VILLA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **10/3/2024 3:26PM**
Date/Time Tested: **10/3/2024 3:39PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.


Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON
Microbiologist

DOH-NRL Cert. No. WMLA-18-0796

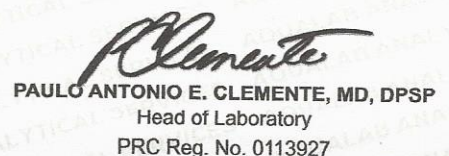

PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

EDTIMA LABRAGUE
BLK 24 LOT 46 MONTECARLO
CARMONA, CAVITE

Certificate No.: **24018113ML**
Account ID: **46CAR0223WSP001**
Sample ID: **J0346**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **10/3/2024 2:10PM**
Collected By: **M. VILLA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **10/3/2024 3:26PM**
Date/Time Tested: **10/3/2024 3:39PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.


Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON
Microbiologist

DOH-NRL Cert. No. WMLA-18-0796



PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

ERNESTO TENORIO
BLK 19 LOT 14 MONTECARLO
CARMONA, CAVITE

Certificate No.: **24018114ML**
Account ID: **46CAR0223WSP001**
Sample ID: **J0347**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **10/3/2024 2:18PM**
Collected By: **M. VILLA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **10/3/2024 3:26PM**
Date/Time Tested: **10/3/2024 3:39PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON
Microbiologist

DOH-NRL Cert. No. WMLA-18-0796



PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927