



AQUALABPH
Integrity in Every Result®



Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

CARMONA NATIONAL HIGH SCHOOL
4116 ROSARIO RD.
CARMONA, CAVITE

Certificate No.: **25006984ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0860**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/8/2025 11:10AM**
Collected By: **L. ARANETA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/8/2025 2:55PM**
Date/Time Tested: **4/8/2025 3:15PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS
NOTHING FOLLOWS				

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.

RONNAMARIE R. MONZON

Microbiologist

DOH-NRL Cert. No. WMLA-18-0796



PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

CARMONA ELEMENTARY SCHOOL
PURIFICACION
CARMONA, CAVITE

Certificate No.: **25006983ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0859**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/8/2025 11:00AM**
Collected By: **L. ARANETA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/8/2025 2:55PM**
Date/Time Tested: **4/8/2025 3:15PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS
NOTHING FOLLOWS				


Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON
Microbiologist
DOH-NRL Cert. No. WMLA-18-0796



PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

PUMPING STATION
CARMONA ELEMENTARY SCHOOL
CARMONA, CAVITE

Certificate No.: **25006982ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0858**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/8/2025 10:55AM**
Collected By: **L. ARANETA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/8/2025 2:55PM**
Date/Time Tested: **4/8/2025 3:15PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS
NOTHING FOLLOWS				


Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.


Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.


RONNAMARIE R. MONZON

Microbiologist
DOH-NRL Cert. No. WMLA-18-0796

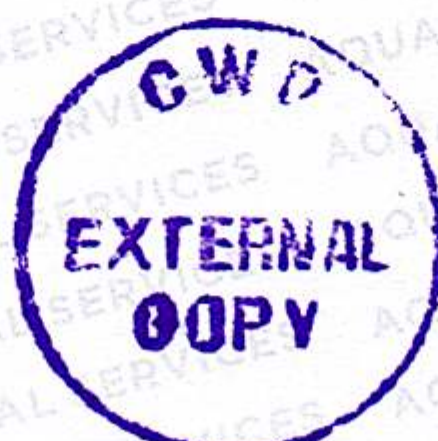


PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

PUMPING STATION
BRGY. MABUHAY
CARMONA, CAVITE

Certificate No.: **25006981ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0857**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/8/2025 10:25AM**
Collected By: **L. ARANETA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/8/2025 2:55PM**
Date/Time Tested: **4/8/2025 3:15PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS
NOTHING FOLLOWS				


Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.


Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.


RONNAMARIE R. MONZON

Microbiologist
DOH-NRL Cert. No. WMLA-18-0796

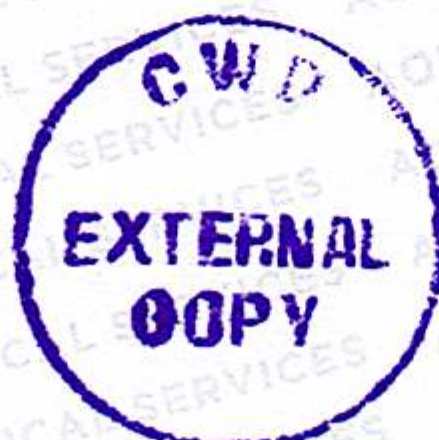


PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

MABUHAY ELEMENTARY SCHOOL
BRGY. MABUHAY
CARMONA, CAVITE

Certificate No.: **25006980ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0856**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/8/2025 10:20AM**
Collected By: **L. ARANETA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/8/2025 2:55PM**
Date/Time Tested: **4/8/2025 3:15PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS
NOTHING FOLLOWS				

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.


Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.


RONNAMARIE R. MONZON

Microbiologist
DOH-NRL Cert. No. WMLA-18-0796




PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

MILAGROSA ELEMENTARY SCHOOL
BRGY. MILAGROSA
CARMONA, CAVITE

Certificate No.: **25006979ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0855**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/8/2025 10:10AM**
Collected By: **L. ARANETA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/8/2025 2:55PM**
Date/Time Tested: **4/8/2025 3:15PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS
NOTHING FOLLOWS				

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.


Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.


RONNAMARIE R. MONZON

Microbiologist
DOH-NRL Cert. No. WMLA-18-0796




PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

PUMPING STATION
MILAGROSA HOMES
CARMONA, CAVITE

Certificate No.: **25006978ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0854**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/8/2025 10:00AM**
Collected By: **L. ARANETA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/8/2025 2:55PM**
Date/Time Tested: **4/8/2025 3:15PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS
NOTHING FOLLOWS				

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.


Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.


RONNAMARIE R. MONZON

Microbiologist
DOH-NRL Cert. No. WMLA-18-0796




PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT ® is a registered trademark of AQUALAB PH

LANTIC ELEMENTARY SCHOOL
BRGY. LANTIC
CARMONA, CAVITE

Certificate No.: **25006977ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0853**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/8/2025 9:45AM**
Collected By: **L. ARANETA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/8/2025 2:55PM**
Date/Time Tested: **4/8/2025 3:15PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS
NOTHING FOLLOWS				

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.


Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEVWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.


RONNAMARIE R. MONZON

Microbiologist
DOH-NRL Cert. No. WMLA-18-0796




PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

PUMPING STATION
BRGY. LANTIC
CARMONA, CAVITE

Certificate No.: **25006976ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0852**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/8/2025 9:35AM**
Collected By: **L. ARANETA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/8/2025 2:55PM**
Date/Time Tested: **4/8/2025 3:15PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS
NOTHING FOLLOWS				

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.


Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.


RONNAMARIE R. MONZON

Microbiologist
DOH-NRL Cert. No. WMLA-18-0796




PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

MILAGROSA WEST ELEMENTARY SCHOOL
PHASE 3 MILAGROSA
CARMONA, CAVITE

Certificate No.: **25006975ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0851**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/8/2025 9:20AM**
Collected By: **L. ARANETA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/8/2025 2:55PM**
Date/Time Tested: **4/8/2025 3:15PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS
NOTHING FOLLOWS				

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.


Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.


RONNAMARIE R. MONZON

Microbiologist
DOH-NRL Cert. No. WMLA-18-0796




PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

PUMPING STATION
MONTECARLO BRGY. BANCAL
CARMONA, CAVITE

Certificate No.: **25006994ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0870**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/8/2025 2:00PM**
Collected By: **L. ARANETA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/8/2025 2:55PM**
Date/Time Tested: **4/8/2025 3:15PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS


Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.


Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.


RONNAMARIE R. MONZON

Microbiologist
DOH-NRL Cert. No. WMLA-18-0796

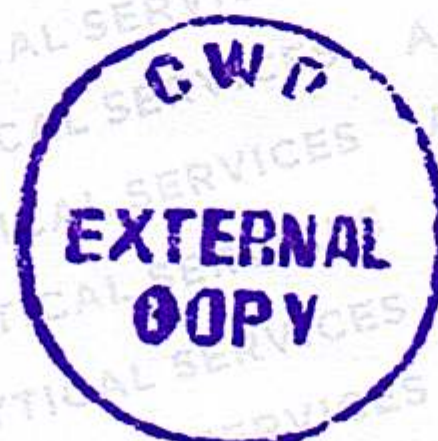


PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

PUMPING STATION

ABUBOT STREET BRGY. BANCAL
CARMONA, CAVITE

Certificate No.: **25006993ML**

Account ID: **46CAR0223WSP001**

Sample ID: **D0869**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/8/2025 1:50PM**
Collected By: **L. ARANETA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/8/2025 2:55PM**
Date/Time Tested: **4/8/2025 3:15PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS
NOTHING FOLLOWS				

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample


Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.


RONNAMARIE R. MONZON

Microbiologist

DOH-NRL Cert. No. WMLA-18-0796




PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

BANCAL ELEMENTARY SCHOOL
GOVERNOR'S DRIVE BRGY. BANCAL
CARMONA, CAVITE

Certificate No.: **25006992ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0868**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/8/2025 1:45PM**
Collected By: **L. ARANETA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/8/2025 2:55PM**
Date/Time Tested: **4/8/2025 3:15PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS
NOTHING FOLLOWS				


Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.


Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.


RONNAMARIE R. MONZON

Microbiologist
DOH-NRL Cert. No. WMLA-18-0796

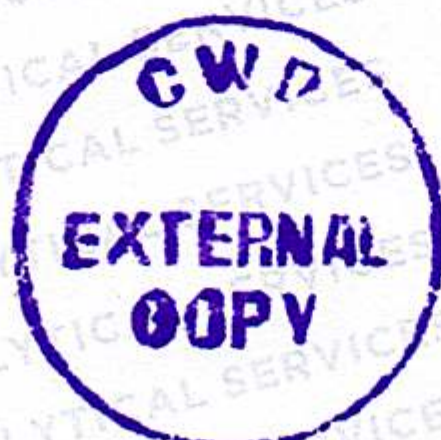


PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

PUMPING STATION

GOVERNOR'S DRIVE BRGY. BANCAL
CARMONA, CAVITE

Certificate No.: **25006991ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0867**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/8/2025 1:35PM**
Collected By: **L. ARANETA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/8/2025 2:55PM**
Date/Time Tested: **4/8/2025 3:15PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS
NOTHING FOLLOWS				

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample


Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.


RONNAMARIE R. MONZON

Microbiologist

DOH-NRL Cert. No. WMLA-18-0796

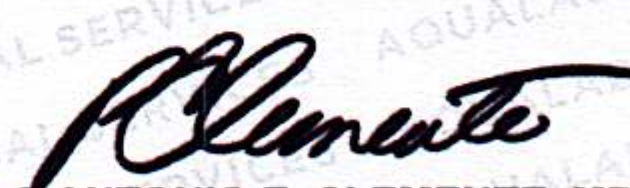


PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

PUMPING STATION

VILLA SOROTEO BRGY. MILAGROSA
CARMONA, CAVITE

Certificate No.: **25006990ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0866**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/8/2025 1:20PM**
Collected By: **L. ARANETA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/8/2025 2:55PM**
Date/Time Tested: **4/8/2025 3:15PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS


Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.


Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.


RONNAMARIE R. MONZON

Microbiologist
DOH-NRL Cert. No. WMLA-18-0796

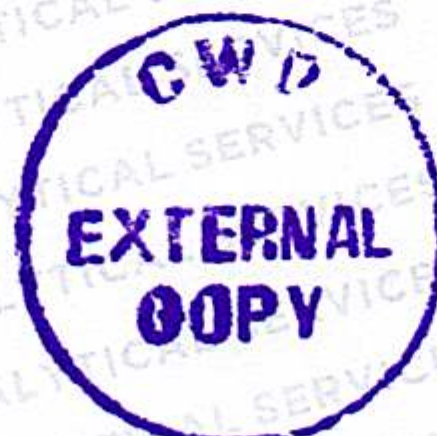


PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

MADUYA ELEMENTARY SCHOOL
BRGY. MADUYA
CARMONA, CAVITE

Certificate No.: **25006989ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0865**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/8/2025 11:45AM**
Collected By: **L. ARANETA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/8/2025 2:55PM**
Date/Time Tested: **4/8/2025 3:15PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample


Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.


RONNAMARIE R. MONZON

Microbiologist

DOH-NRL Cert. No. WMLA-18-0796




PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT ® is a registered trademark of AQUALAB PH

CAVSU CARMONA
MARKET ROAD
CARMONA, CAVITE

Certificate No.: **25006988ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0864**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/8/2025 11:40AM**
Collected By: **L. ARANETA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/8/2025 2:55PM**
Date/Time Tested: **4/8/2025 3:15PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS


Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.


Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.


RONNAMARIE R. MONZON

Microbiologist
DOH-NRL Cert. No. WMLA-18-0796

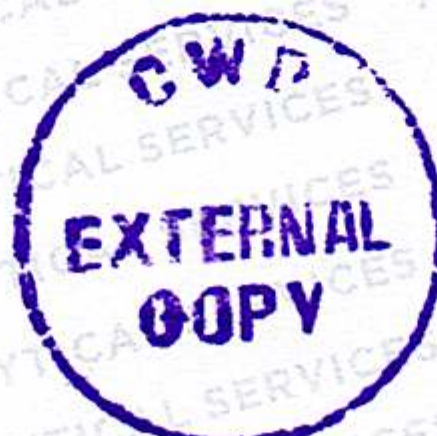

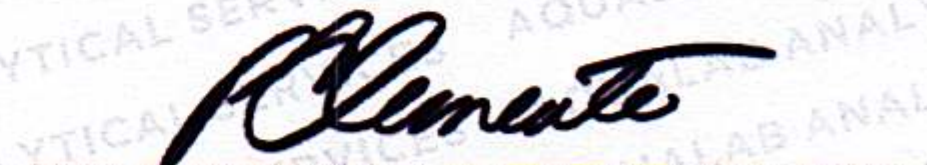
PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT ® is a registered trademark of AQUALAB PH

PUMPING STATION
BRGY. MADUYA
CARMONA, CAVITE

Certificate No.: **25006987ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0863**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/8/2025 11:30AM**
Collected By: **L. ARANETA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/8/2025 2:55PM**
Date/Time Tested: **4/8/2025 3:15PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS
NOTHING FOLLOWS				

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample


Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.


RONNAMARIE R. MONZON

Microbiologist

DOH-NRL Cert. No. WMLA-18-0796

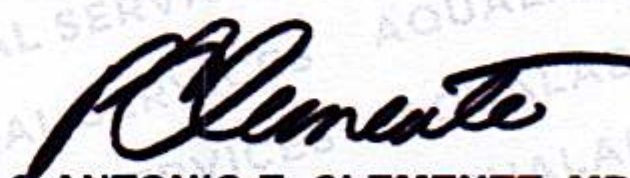


PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

CABILANG BAYBAY ELEMENTARY SCHOOL
SAN MATEO, CABILANG BAYBAY
CARMONA, CAVITE

Certificate No.: **25006986ML**
Account ID: **46CAR0223WSP001**
Sample ID: **D0862**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **4/8/2025 11:20AM**
Collected By: **L. ARANETA**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **4/8/2025 2:55PM**
Date/Time Tested: **4/8/2025 3:15PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS
NOTHING FOLLOWS				


Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON
Microbiologist
DOH-NRL Cert. No. WMLA-18-0796



PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927