

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

Certificate No.: **25008453ML**
Account ID: **46CAR0223WSP001**
Sample ID: **E06136**

BITOLINAMESA JERRY
BLOCK 20 LOT 20 BMW ST. MONTE CARIO
CARMONA, CAVITE

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **5/6/2025 2:25PM**
Collected By: **G. TAPANG**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **5/6/2025 4:24PM**
Date/Time Tested: **5/6/2025 4:30PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample



Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON

Microbiologist

DOH-NRL Cert. No. WMLA-18-0796



PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

ROWENA ALCANTARA
ABANDONED ROAD BANCAL
CARMONA, CAVITE

Certificate No.: **25008452ML**
Account ID: **46CAR0223WSP001**
Sample ID: **E06135**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **5/6/2025 2:13PM**
Collected By: **G. TAPANG**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **5/6/2025 4:24PM**
Date/Time Tested: **5/6/2025 4:30PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample


Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON

Microbiologist

DOH-NRL Cert. No. WMLA-18-0796



PAULO ANTONIO E. CLEMENTE, MD, DPSP

Head of Laboratory

PRC Reg. No. 0113927

MERCADO VICTORIANO
ABANDONED ROAD BANCAL
CARMONA, CAVITE

Certificate No.: **25008451ML**
Account ID: **46CAR0223WSP001**
Sample ID: **E06134**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **5/6/2025 2:00PM**
Collected By: **G. TAPANG**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **5/6/2025 4:24PM**
Date/Time Tested: **5/6/2025 4:30PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample



Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON

Microbiologist

DOH-NRL Cert. No. WMLA-18-0796



PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

MARY JANE ALBAY
BANCAL MAUNIS COMPOUND
CARMONA, CAVITE

Certificate No.: **25008450ML**
Account ID: **46CAR0223WSP001**
Sample ID: **E06133**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **5/6/2025 1:53PM**
Collected By: **G. TAPANG**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **5/6/2025 4:24PM**
Date/Time Tested: **5/6/2025 4:30PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample


Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON

Microbiologist

DOH-NRL Cert. No. WMLA-18-0796



PAULO ANTONIO E. CLEMENTE, MD, DPSP

Head of Laboratory

PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

AUSTRIA ANTONIO
9162 BULUNGAN MADUYA
CARMONA, CAVITE

Certificate No.: **25008449ML**
Account ID: **46CAR0223WSP001**
Sample ID: **E06132**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **5/6/2025 11:50AM**
Collected By: **G. TAPANG**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **5/6/2025 4:24PM**
Date/Time Tested: **5/6/2025 4:30PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	1	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON

Microbiologist

DOH-NRL Cert. No. WMLA-18-0796



PAULO ANTONIO E. CLEMENTE, MD, DPSP

Head of Laboratory
PRC Reg. No. 0113927

DE PEDRO JULIE
BANCAL CORE HOUSE
CARMONA, CAVITE

Certificate No.: **25008448ML**
Account ID: **46CAR0223WSP001**
Sample ID: **E06131**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **5/6/2025 11:40AM**
Collected By: **G. TAPANG**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **5/6/2025 4:24PM**
Date/Time Tested: **5/6/2025 4:30PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample


Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON

Microbiologist

DOH-NRL Cert. No. WMLA-18-0796



PAULO ANTONIO E. CLEMENTE, MD, DPSP

Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

CANDELARIA EDWARD
8175, ROSARIO ST. BRGY 8
CARMONA, CAVITE

Certificate No.: **25008447ML**
Account ID: **46CAR0223WSP001**
Sample ID: **E06130**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **5/6/2025 11:35AM**
Collected By: **G. TAPANG**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **5/6/2025 4:24PM**
Date/Time Tested: **5/6/2025 4:30PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS



Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON
Microbiologist
DOH-NRL Cert. No. WMLA-18-0796



PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

DELOS REYES ROMEO 2

8265E ZAMORA ST. ROSARIO, BGRY. 8
CARMONA, CAVITE

Certificate No.: **25008446ML**
Account ID: **46CAR0223WSP001**
Sample ID: **E06129**

Requested by: CARMONA WATER DISTRICT
Main Source: C.W.D.
Water Purpose (Use): DRINKING
Date/Time Collected: 5/6/2025 11:23AM
Collected By: G. TAPANG

Sampling Point: FAUCET
Type of Water: CHLORINATED
Date/Time Received: 5/6/2025 4:24PM
Date/Time Tested: 5/6/2025 4:30PM

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample


Notes/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON

Microbiologist

DOH-NRL Cert. No. WMLA-18-0796



PAULO ANTONIO E. CLEMENTE, MD, DPSP

Head of Laboratory

PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

TORRES EMELIA
11320 MAPALAD ST. MABUHAY
CARMONA, CAVITE

Certificate No.: **25008445ML**
Account ID: **46CAR0223WSP001**
Sample ID: **E06128**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **5/6/2025 11:15AM**
Collected By: **G. TAPANG**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **5/6/2025 4:24PM**
Date/Time Tested: **5/6/2025 4:30PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample



Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON

Microbiologist

DOH-NRL Cert. No. WMLA-18-0796



PAULO ANTONIO E. CLEMENTE, MD, DPSP

Head of Laboratory
PRC Reg. No. 0113927

BRGY. OUTPOST
HEBRON ST.
CARMONA, CAVITE

Certificate No.: **25008444ML**
Account ID: **46CAR0223WSP001**
Sample ID: **E06127**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **5/6/2025 11:10AM**
Collected By: **G. TAPANG**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **5/6/2025 4:24PM**
Date/Time Tested: **5/6/2025 4:30PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample



Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON

Microbiologist

DOH-NRL Cert. No. WMLA-18-0796



PAULO ANTONIO E. CLEMENTE, MD, DPSP

Head of Laboratory

PRC Reg. No. 0113927

CABIGAN EDITACIO

11495 ALUMIA ST. MABUHAY
CARMONA, CAVITE

Certificate No.: **25008443ML**

Account ID: **46CAR0223WSP001**

Sample ID: **E06126**

Requested by: CARMONA WATER DISTRICT
Main Source: C.W.D.
Water Purpose (Use): DRINKING
Date/Time Collected: 5/6/2025 11:00AM
Collected By: G. TAPANG

Sampling Point: FAUCET
Type of Water: CHLORINATED
Date/Time Received: 5/6/2025 4:24PM
Date/Time Tested: 5/6/2025 4:30PM

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample



Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON

Microbiologist

DOH-NRL Cert. No. WMLA-18-0796



PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

CANITA MARK ANTHONY
1261 MILAGROSA
CARMONA, CAVITE

Certificate No.: **25008442ML**
Account ID: **46CAR0223WSP001**
Sample ID: **E06125**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **5/6/2025 10:54AM**
Collected By: **G. TAPANG**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **5/6/2025 4:24PM**
Date/Time Tested: **5/6/2025 4:30PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEVW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample


Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON

Microbiologist

DOH-NRL Cert. No. WMLA-18-0796



PAULO ANTONIO E. CLEMENTE, MD, DPSP

Head of Laboratory
PRC Reg. No. 0113927

SALMORIN ROWENA

BLOCK 10 LOT 73A MILAGROSA HOMES
CARMONA, CAVITE

Certificate No.: **25008441ML**

Account ID: **46CAR0223WSP001**

Sample ID: **E06124**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **5/6/2025 10:45AM**
Collected By: **G. TAPANG**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **5/6/2025 4:24PM**
Date/Time Tested: **5/6/2025 4:30PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.

Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.

Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEVW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample


Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON

Microbiologist

DOH-NRL Cert. No. WMLA-18-0796



PAULO ANTONIO E. CLEMENTE, MD, DPSP

Head of Laboratory

PRC Reg. No. 0113927

MALABANAN JOSEPH

BLOCK 6 PHASE 1 MACARIA VILLAGE MILAGROSA
CARMONA, CAVITE

Certificate No.: **25008440ML**

Account ID: **46CAR0223WSP001**

Sample ID: **E06123**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **5/6/2025 10:35AM**
Collected By: **G. TAPANG**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **5/6/2025 4:24PM**
Date/Time Tested: **5/6/2025 4:30PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	3	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.

Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.

Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample


Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON

Microbiologist

DOH-NRL Cert. No. WMLA-18-0796



PAULO ANTONIO E. CLEMENTE, MD, DPSP

Head of Laboratory

PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

QUIJANO LEBRADO
1365 LANTIC
CARMONA, CAVITE

Certificate No.: **25008439ML**
Account ID: **46CAR0223WSP001**
Sample ID: **E06122**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **5/6/2025 10:21AM**
Collected By: **G. TAPANG**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **5/6/2025 4:24PM**
Date/Time Tested: **5/6/2025 4:30PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.


Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEVWV), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.




RONNAMARIE R. MONZON

Microbiologist
DOH-NRL Cert. No. WMLA-18-0796


PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

BENJAMIN BIANZON
BLOCK 14 LOT 11 PHASE 2 MILAGROSA
CARMONA, CAVITE

Certificate No.: **25008438ML**
Account ID: **46CAR0223WSP001**
Sample ID: **E06121**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **5/6/2025 10:12AM**
Collected By: **G. TAPANG**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **5/6/2025 4:24PM**
Date/Time Tested: **5/6/2025 4:30PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample


Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON

Microbiologist

DOH-NRL Cert. No. WMLA-18-0796



PAULO ANTONIO E. CLEMENTE, MD, DPSP

Head of Laboratory

PRC Reg. No. 0113927

Aqualab Analytical Services Inc. Operating under the name "AQUALAB PH"
Block 39 Lot 1&3 Green Estate 3 Malagasang I-G Imus City 4103 Cavite
Tel. No.: (046) 686 3704 | Mobile No. 0919 087 4880 | Email: info@aqualabph.com
AQUALABPH INTEGRITY IN EVERY RESULT® is a registered trademark of AQUALAB PH

BRASINO ROJELLO
BLOCK 16 LOT 2C MILAGROSA
CARMONA, CAVITE

Certificate No.: **25008437ML**
Account ID: **46CAR0223WSP001**
Sample ID: **E06120**

Requested by: **CARMONA WATER DISTRICT**
Main Source: **C.W.D.**
Water Purpose (Use): **DRINKING**
Date/Time Collected: **5/6/2025 10:00AM**
Collected By: **G. TAPANG**

Sampling Point: **FAUCET**
Type of Water: **CHLORINATED**
Date/Time Received: **5/6/2025 4:24PM**
Date/Time Tested: **5/6/2025 4:30PM**

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	47	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample



Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON

Microbiologist

DOH-NRL Cert. No. WMLA-18-0796

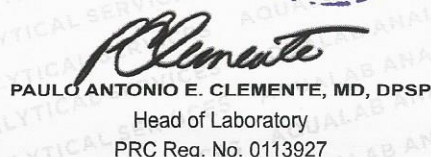

PAULO ANTONIO E. CLEMENTE, MD, DPSP
Head of Laboratory
PRC Reg. No. 0113927

PALMA AIRENE

19,12 PHASE 3 MILAGROSA
CARMONA, CAVITE

Certificate No.: **25008436ML**Account ID: **46CAR0223WSP001**Sample ID: **E06119**

Requested by: CARMONA WATER DISTRICT
Main Source: C.W.D.
Water Purpose (Use): DRINKING
Date/Time Collected: 5/6/2025 9:53AM
Collected By: G. TAPANG

Sampling Point: FAUCET
Type of Water: CHLORINATED
Date/Time Received: 5/6/2025 4:24PM
Date/Time Tested: 5/6/2025 4:30PM

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	< 1,0	< 500	PASS

*****NOTHING FOLLOWS*****

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.

**RONNAMARIE R. MONZON**

Microbiologist

DOH-NRL Cert. No. WMLA-18-0796

**PAULO ANTONIO E. CLEMENTE, MD, DPSP**

Head of Laboratory

PRC Reg. No. 0113927

MARIETA UMANDAP

9076 PATINDIG ARAW, MILAGROSA
CARMONA, CAVITE

Requested by: CARMONA WATER DISTRICT
Main Source: C.W.D.
Water Purpose (Use): DRINKING
Date/Time Collected: 5/6/2025 9:40AM
Collected By: G. TAPANG

Certificate No.: **25008435ML**
Account ID: 46CAR0223WSP001
Sample ID: E06118

Sampling Point: FAUCET
Type of Water: CHLORINATED
Date/Time Received: 5/6/2025 4:24PM
Date/Time Tested: 5/6/2025 4:30PM

CERTIFICATE OF MICROBIOLOGICAL ANALYSIS

PARAMETER	METHOD OF ANALYSIS	RESULT	LIMIT	REMARKS
Total Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Thermotolerant Coliform, MPN/100mL	9221 Multiple Tube Fermentation Technique	< 1,1	< 1,1	PASS
Heterotrophic Plate Count, cfu/mL	9215 B. Pour Plate Method	26	< 500	PASS

NOTHING FOLLOWS

Remarks: Results of examination are specifically related to samples as received.
Pursuant to PNSDW 2017, sample was collected according to prescribed aseptic technique and was contained and transported in a sterilized container at controlled temperature by Aqualab PH trained personnel.
Sample analysis was conducted within eight (8) hours as prescribed by the standards.

Reference/s: Methods of Analysis are based on the Standard Methods for the Examination of Water and Wastewater (SMEWW), American Public Health Association, American Water Works Association, 22nd Edition (2012); Parameters and Limits are based on Philippine National Standards for Drinking Water (2017)
Thermotolerant Coliform – also Fecal Coliform; MPN/100mL – Most Probable Number per 100mL of sample; cfu – Colony Forming Unit per 1mL of sample

Note/s: Comma (,) is used in this report to emphasize presentation of decimal separation/s.



RONNAMARIE R. MONZON

Microbiologist

DOH-NRL Cert. No. WMLA-18-0796



PAULO ANTONIO E. CLEMENTE, MD, DPSP

Head of Laboratory

PRC Reg. No. 0113927